


Certificate of Portable Appliance Testing

Peter Black.
9 Leicester Road,
Wanstead,
London, E11 2DW.

Retest Date: Oct 2015

This Certificates that all
appliances listed inside have been Inspected
and Tested to meet with the
“Electricity at Work Regulation 1989”

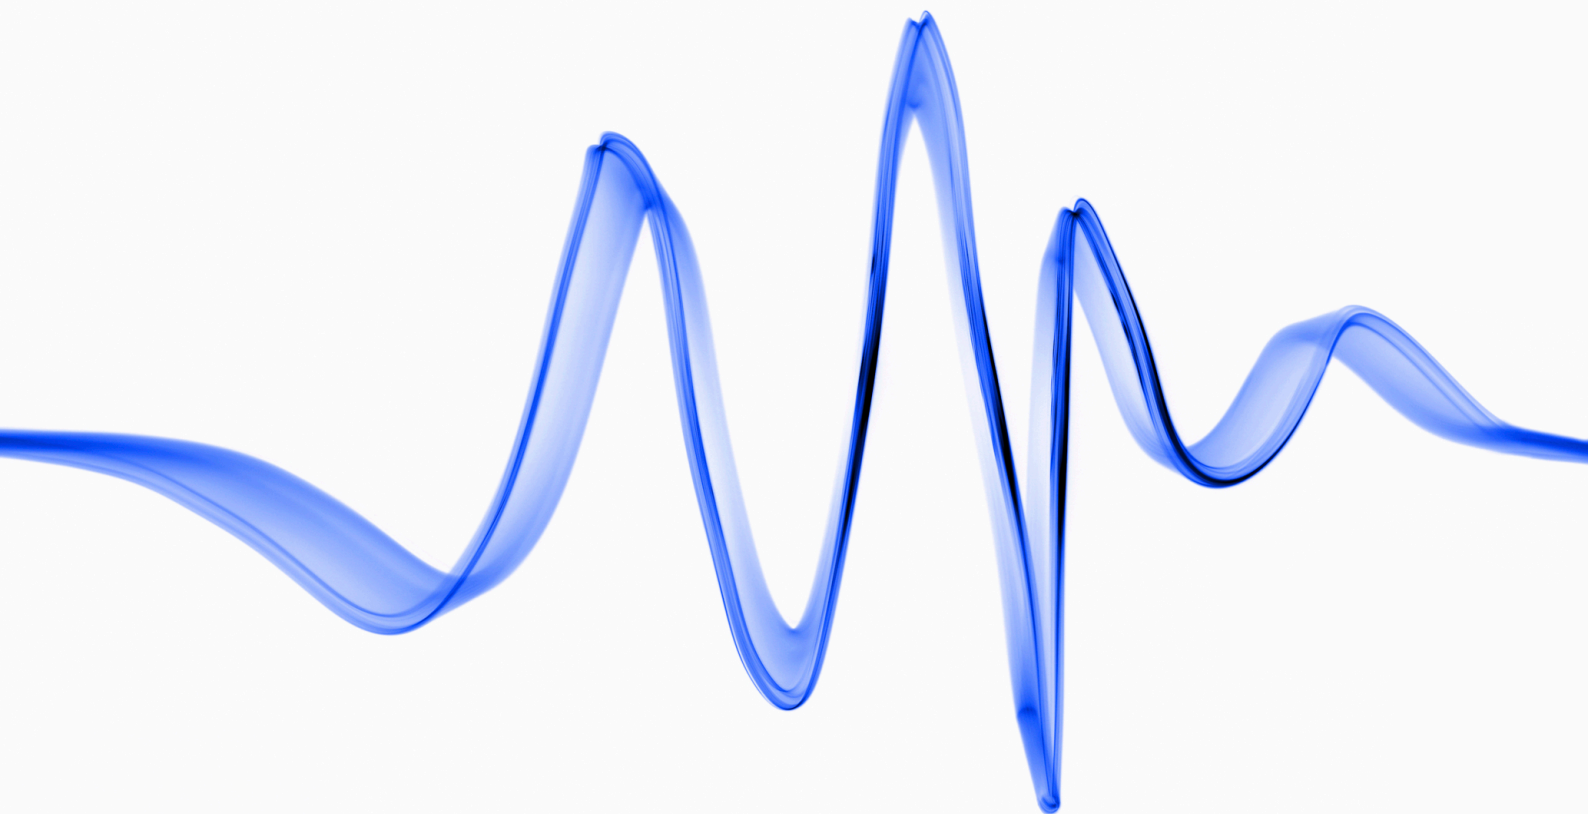

Portable Appliance Testing

Client:		Site: PETER BLACK			Location: ON SITE		Last Test	Next Test
Asset ID	Description							
16073	BATT CHARGER				03/10/2014	03/10/2015	03/10/2014	
L27057	PEDAL BOX				03/10/2014	03/10/2015	03/10/2014	
L27059	ACU AMP				03/10/2014	03/10/2015	03/10/2014	
L27060	AC ADAPTOR				03/10/2014	03/10/2015	03/10/2014	
L27067	GIT AMP				03/10/2014	03/10/2015	03/10/2014	
L27068	AC ADAPTOR				03/10/2014	03/10/2015	03/10/2014	
L27069	MULTI PEDALS				03/10/2014	03/10/2015	03/10/2014	
L27070	IEC LEAD				03/10/2014	03/10/2015	03/10/2014	
L27071	PEDAL				03/10/2014	03/10/2015	03/10/2014	
L27072	IEC LEAD				03/10/2014	03/10/2015	03/10/2014	
L27073	MONITOR SPEAKER				03/10/2014	03/10/2015	03/10/2014	
L27074	IEC LEAD				03/10/2014	03/10/2015	03/10/2014	
L27075	MONITOR SPEAKER				03/10/2014	03/10/2015	03/10/2014	
L27076	IEC LEAD				03/10/2014	03/10/2015	03/10/2014	
L27077	MACKIE MIXER				03/10/2014	03/10/2015	03/10/2014	
L27078	CD PLAYER				03/10/2014	03/10/2015	03/10/2014	
L28264	AC ADAPTOR				03/10/2014	03/10/2015	03/10/2014	
L28265	BOSS FX PEDEL				03/10/2014	03/10/2015	03/10/2014	
L31145	IEC LEAD				03/10/2014	03/10/2015	03/10/2014	
L31146	IEC LEAD				03/10/2014	03/10/2015	03/10/2014	
L31147	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L31148	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L31149	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L31150	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L31151	AC ADAPTOR				03/10/2014	03/10/2015	03/10/2014	
L33334	IEC LEAD				03/10/2014	03/10/2015	03/10/2014	
L33335	AC ADAPTOR				03/10/2014	03/10/2015	03/10/2014	
L33338	AC ADAPTOR				03/10/2014	03/10/2015	03/10/2014	
L33340	AC ADAPTOR				03/10/2014	03/10/2015	03/10/2014	
L41069	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L41070	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L41072	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L41073	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L41077	IEC LEAD				03/10/2014	03/10/2015	03/10/2014	
L41078	GUITAR AMP				03/10/2014	03/10/2015	03/10/2014	
L41080	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L41081	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L41082	LAMP				03/10/2014	03/10/2015	03/10/2014	
L41085	EXT LEAD				03/10/2014	03/10/2015	03/10/2014	
L41086	TAPE DECK				03/10/2014	03/10/2015	03/10/2014	
L41087	9MP				03/10/2014	03/10/2015	03/10/2014	
L41088	AMP				03/10/2014	03/10/2015	03/10/2014	
L49627	HEATER				03/10/2014	03/10/2015	03/10/2014	
L49629	2 PIN LEAD				03/10/2014	03/10/2015	03/10/2014	
L49630	PRINTER				03/10/2014	03/10/2015	03/10/2014	

Total Assets: 45

Portable Appliance Testing

Site: PETER BLACK		Location: ON SITE			
Asset ID: 16073		Description: BATT CHARGER		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
Insulation Voltage	03/10/2014	250	V	Information	
Insulation	03/10/2014	> 199	MOhm	Pass	
Live - Neutral Voltage	03/10/2014	245	V	Information	
Live Voltage	03/10/2014	240	V	Information	
Neutral Voltage	03/10/2014	6	V	Information	
Load Current	03/10/2014	< 0.50	A	Information	
Touch Current	03/10/2014	< 0.07	mA	Pass	
Overall: Pass					
Asset ID: L27057		Description: PEDAL BOX		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
Insulation Voltage	03/10/2014	250	V	Information	
Insulation	03/10/2014	> 199	MOhm	Pass	
Live - Neutral Voltage	03/10/2014	247	V	Information	
Live Voltage	03/10/2014	239	V	Information	
Neutral Voltage	03/10/2014	6	V	Information	
Load Current	03/10/2014	< 0.50	A	Information	
Touch Current	03/10/2014	< 0.07	mA	Pass	
Overall: Pass					
Asset ID: L27059		Description: ACU AMP		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
Insulation Voltage	03/10/2014	500	V	Information	
Insulation	03/10/2014	> 199	MOhm	Pass	
Overall: Pass					
Asset ID: L27060		Description: AC ADAPTOR		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
Insulation Voltage	03/10/2014	250	V	Information	
Insulation	03/10/2014	> 199	MOhm	Pass	
Live - Neutral Voltage	03/10/2014	246	V	Information	
Live Voltage	03/10/2014	237	V	Information	
Neutral Voltage	03/10/2014	6	V	Information	
Load Current	03/10/2014	< 0.50	A	Information	
Touch Current	03/10/2014	< 0.07	mA	Pass	
Overall: Pass					
Asset ID: L27067		Description: GIT AMP		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
Insulation Voltage	03/10/2014	250	V	Information	
Insulation	03/10/2014	> 199	MOhm	Pass	
Live - Neutral Voltage	03/10/2014	245	V	Information	
Live Voltage	03/10/2014	236	V	Information	
Neutral Voltage	03/10/2014	6	V	Information	
Load Current	03/10/2014	< 0.50	A	Information	
Touch Current	03/10/2014	< 0.07	mA	Pass	
Overall: Pass					
Asset ID: L27068		Description: AC ADAPTOR		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
Insulation Voltage	03/10/2014	250	V	Information	
Insulation	03/10/2014	> 199	MOhm	Pass	
Live - Neutral Voltage	03/10/2014	244	V	Information	
Live Voltage	03/10/2014	238	V	Information	
Neutral Voltage	03/10/2014	6	V	Information	
Load Current	03/10/2014	< 0.50	A	Information	
Touch Current	03/10/2014	< 0.07	mA	Pass	
Overall: Pass					
Asset ID: L27069		Description: MULTI PEDALS		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	

Portable Appliance Testing

Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	244	V	Information
Live Voltage	03/10/2014	240	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
Touch Current	03/10/2014	< 0.07	mA	Pass

Overall: Pass

Asset ID: L27070	Description: IEC LEAD	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
IEC Lead Continuity	03/10/2014	0.046	ohm	Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	96	MOhm	Pass
IEC Lead Polarity	03/10/2014			Pass

Overall: Pass

Asset ID: L27071	Description: PEDAL	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Earth Continuity	03/10/2014	0.06	ohm	Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	244	V	Information
Live Voltage	03/10/2014	240	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
PE Conductor Current	03/10/2014	< 0.15	mA	Pass

Overall: Pass

Asset ID: L27072		Description: IEC LEAD		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
IEC Lead Continuity	03/10/2014	0.048	ohm	Pass	
Insulation Voltage	03/10/2014	500	V	Information	
Insulation	03/10/2014	98	MOhm	Pass	
IEC Lead Polarity	03/10/2014			Pass	

Overall: Pass

Asset ID: L27073		Description: MONITOR SPEAKER		User: ALEX		Test Instrument: 06E-0826	
Test Type		Date	Result	Unit	Status		
Visual		03/10/2014			Pass		
Insulation Voltage		03/10/2014	500	V	Information		
Insulation		03/10/2014	> 199	MOhm	Pass		

Overall: Pass

Asset ID: L27074		Description: IEC LEAD		User: ALEX		Test Instrument: 06E-0826			
Test Type		Date		Result		Unit		Status	
Visual		03/10/2014						Pass	
IEC Lead Continuity		03/10/2014		0.074		ohm		Pass	
Insulation Voltage		03/10/2014		500		V		Information	
Insulation		03/10/2014		99		MOhm		Pass	
IEC Lead Polarity		03/10/2014						Pass	

Overall: Pass

Asset ID: L27075		Description: MONITOR SPEAKER		User: ALEX		Test Instrument: 06E-0826			
Test Type		Date		Result		Unit		Status	
Visual		03/10/2014						Pass	
Insulation Voltage		03/10/2014		500		V		Information	
Insulation		03/10/2014		> 199		MOhm		Pass	

Overall: Pass

Asset ID: L27076		Description: IEC LEAD		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
IEC Lead Continuity	03/10/2014	0.136	ohm	Pass	
Insulation Voltage	03/10/2014	500	V	Information	
Insulation	03/10/2014	98	MOhm	Pass	
IEC Lead Polarity	03/10/2014			Pass	

Overall: Pass

Portable Appliance Testing

Asset ID: L27077		Description: MACKIE MIXER		User: ALEX		Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status			
Visual	03/10/2014			Pass			
Earth Continuity	03/10/2014	0.084	ohm	Pass			
Insulation Voltage	03/10/2014	500	V	Information			
Insulation	03/10/2014	> 199	MOhm	Pass			
							Overall: Pass

Asset ID: L27078	Description: CD PLAYER	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	246	V	Information
Live Voltage	03/10/2014	237	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
Touch Current	03/10/2014	< 0.07	mA	Pass
Overall: Pass				

Asset ID: L28264		Description: AC ADAPTOR		User: ALEX		Test Instrument: 06E-0826	
Test Type		Date	Result	Unit	Status		
Visual		03/10/2014			Pass		
Insulation Voltage		03/10/2014	250	V	Information		
Insulation		03/10/2014	> 199	MOhm	Pass		
Live - Neutral Voltage		03/10/2014	244	V	Information		
Live Voltage		03/10/2014	240	V	Information		
Neutral Voltage		03/10/2014	6	V	Information		
Load Current		03/10/2014	< 0.50	A	Information		
Touch Current		03/10/2014	< 0.07	mA	Pass		
Overall: Pass							

Asset ID: L28265		Description: BOSS FX PEDEL		User: ALEX		Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status			
Visual	03/10/2014			Pass			
Insulation Voltage	03/10/2014	250	V	Information			
Insulation	03/10/2014	> 199	MOhm	Pass			
Live - Neutral Voltage	03/10/2014	243	V	Information			
Live Voltage	03/10/2014	238	V	Information			
Neutral Voltage	03/10/2014	6	V	Information			
Load Current	03/10/2014	< 0.50	A	Information			
Touch Current	03/10/2014	< 0.07	mA	Pass			
Overall: Pass							

Asset ID: L31145		Description: IEC LEAD		User: ALEX		Test Instrument: 06E-0826			
Test Type		Date		Result		Unit		Status	
Visual		03/10/2014						Pass	
IEC Lead Continuity		03/10/2014		0.056		ohm		Pass	
Insulation Voltage		03/10/2014		500		V		Information	
Insulation		03/10/2014		98		MOhm		Pass	
IEC Lead Polarity		03/10/2014						Pass	
Overall: Pass									

Asset ID: L31146		Description: IEC LEAD		User: ALEX		Test Instrument: 06E-0826			
Test Type		Date		Result		Unit		Status	
Visual		03/10/2014						Pass	
IEC Lead Continuity		03/10/2014		0.048		ohm		Pass	
Insulation Voltage		03/10/2014		500		V		Information	
Insulation		03/10/2014		96		MOhm		Pass	
IEC Lead Polarity		03/10/2014						Pass	
Overall: Pass									

Asset ID: L31147		Description: EXT LEAD		User: ALEX		Test Instrument: 06E-0826	
Test Type		Date	Result	Unit	Status		
Visual		03/10/2014			Pass		
IEC Lead Continuity		03/10/2014	0.1	ohm	Pass		
Insulation Voltage		03/10/2014	500	V	Information		
Insulation		03/10/2014	93	MOhm	Pass		
IEC Lead Polarity		03/10/2014			Pass		
Overall: Pass							

Portable Appliance Testing

Asset ID: L31148	Description: EXT LEAD	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
IEC Lead Continuity	03/10/2014	0.124	ohm	Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	96	MOhm	Pass
IEC Lead Polarity	03/10/2014			Pass
Overall: Pass				

Asset ID: L31149	Description: EXT LEAD	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
IEC Lead Continuity	03/10/2014	0.186	ohm	Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	92	MOhm	Pass
IEC Lead Polarity	03/10/2014			Pass
Overall: Pass				

Asset ID: L31150	Description: EXT LEAD	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
IEC Lead Continuity	03/10/2014	0.17	ohm	Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	96	MOhm	Pass
IEC Lead Polarity	03/10/2014			Pass
Overall: Pass				

Asset ID: L31151	Description: AC ADAPTOR	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	247	V	Information
Live Voltage	03/10/2014	238	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
Touch Current	03/10/2014	< 0.07	mA	Pass
Overall: Pass				

Asset ID: L33334	Description: IEC LEAD	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
IEC Lead Continuity	03/10/2014	0.084	ohm	Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	99	MOhm	Pass
IEC Lead Polarity	03/10/2014			Pass
Overall: Pass				

Asset ID: L33335	Description: AC ADAPTOR	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	246	V	Information
Live Voltage	03/10/2014	238	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
Touch Current	03/10/2014	< 0.07	mA	Pass
Overall: Pass				

Asset ID: L33338	Description: AC ADAPTOR	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	247	V	Information
Live Voltage	03/10/2014	239	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
Touch Current	03/10/2014	< 0.07	mA	Pass
Overall: Pass				

Portable Appliance Testing

Asset ID: L33340	Description: AC ADAPTOR	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	246	V	Information
Live Voltage	03/10/2014	240	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
Touch Current	03/10/2014	< 0.07	mA	Pass
Overall: Pass				
Asset ID: L41069	Description: EXT LEAD	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
IEC Lead Continuity	03/10/2014	0.194	ohm	Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	91	MOhm	Pass
IEC Lead Polarity	03/10/2014			Pass
Overall: Pass				
Asset ID: L41070	Description: EXT LEAD	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
IEC Lead Continuity	03/10/2014	0.1	ohm	Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	96	MOhm	Pass
IEC Lead Polarity	03/10/2014			Pass
Overall: Pass				
Asset ID: L41072	Description: EXT LEAD	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
IEC Lead Continuity	03/10/2014	0.098	ohm	Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	97	MOhm	Pass
IEC Lead Polarity	03/10/2014			Pass
Overall: Pass				
Asset ID: L41073	Description: EXT LEAD	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
IEC Lead Continuity	03/10/2014	0.056	ohm	Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	96	MOhm	Pass
IEC Lead Polarity	03/10/2014			Pass
Overall: Pass				
Asset ID: L41077	Description: IEC LEAD	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
IEC Lead Continuity	03/10/2014	0.066	ohm	Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	97	MOhm	Pass
IEC Lead Polarity	03/10/2014			Pass
Overall: Pass				
Asset ID: L41078	Description: GUITAR AMP	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Earth Continuity	03/10/2014	0.084	ohm	Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	244	V	Information
Live Voltage	03/10/2014	237	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
PE Conductor Current	03/10/2014	< 0.15	mA	Pass
Overall: Pass				

Portable Appliance Testing

Asset ID: L41080		Description: EXT LEAD		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
IEC Lead Continuity	03/10/2014	0.056	ohm	Pass	
Insulation Voltage	03/10/2014	500	V	Information	
Insulation	03/10/2014	97	MOhm	Pass	
IEC Lead Polarity	03/10/2014			Pass	

Overall: Pass

Asset ID: L41081		Description: EXT LEAD		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
IEC Lead Continuity	03/10/2014	0.046	ohm	Pass	
Insulation Voltage	03/10/2014	500	V	Information	
Insulation	03/10/2014	98	MOhm	Pass	
IEC Lead Polarity	03/10/2014			Pass	

Overall: Pass

Asset ID: L41082	Description: LAMP	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	245	V	Information
Live Voltage	03/10/2014	239	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
Touch Current	03/10/2014	< 0.07	mA	Pass

Overall: Pass

Asset ID: L41085		Description: EXT LEAD		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
IEC Lead Continuity	03/10/2014	0.028	ohm	Pass	
Insulation Voltage	03/10/2014	500	V	Information	
Insulation	03/10/2014	> 199	MOhm	Pass	
IEC Lead Polarity	03/10/2014			Pass	

Overall: Pass

Asset ID: L41086		Description: TAPE DECK		User: ALEX		Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status			
Visual	03/10/2014			Pass			
Insulation Voltage	03/10/2014	250	V	Information			
Insulation	03/10/2014	> 199	MOhm	Pass			
Live - Neutral Voltage	03/10/2014	246	V	Information			
Live Voltage	03/10/2014	240	V	Information			
Neutral Voltage	03/10/2014	6	V	Information			
Load Current	03/10/2014	< 0.50	A	Information			
Touch Current	03/10/2014	< 0.07	mA	Pass			

Overall: Pass

Asset ID: L41087		Description: 9MP		User: ALEX	Test Instrument: 06E-0826
Test Type	Date	Result	Unit	Status	
Visual	03/10/2014			Pass	
Insulation Voltage	03/10/2014	250	V	Information	
Insulation	03/10/2014	> 199	MOhm	Pass	
Live - Neutral Voltage	03/10/2014	245	V	Information	
Live Voltage	03/10/2014	240	V	Information	
Neutral Voltage	03/10/2014	6	V	Information	
Load Current	03/10/2014	< 0.50	A	Information	
Touch Current	03/10/2014	< 0.07	mA	Pass	

Overall: Pass

Asset ID: L41088	Description: AMP	User: ALEX	Test Instrument: 06E-0826	
Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	247	V	Information
Live Voltage	03/10/2014	240	V	Information
Neutral Voltage	03/10/2014	6	V	Information

Portable Appliance Testing

Load Current	03/10/2014	< 0.50	A	Information
Touch Current	03/10/2014	< 0.07	mA	Pass

Overall: Pass

Asset ID: L49627	Description: HEATER	User: ALEX	Test Instrument: 06E-0826
------------------	---------------------	------------	---------------------------

Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	246	V	Information
Live Voltage	03/10/2014	238	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
Touch Current	03/10/2014	< 0.07	mA	Pass

Overall: Pass

Asset ID: L49629	Description: 2 PIN LEAD	User: ALEX	Test Instrument: 06E-0826
------------------	-------------------------	------------	---------------------------

Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Insulation Voltage	03/10/2014	250	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass
Live - Neutral Voltage	03/10/2014	245	V	Information
Live Voltage	03/10/2014	237	V	Information
Neutral Voltage	03/10/2014	6	V	Information
Load Current	03/10/2014	< 0.50	A	Information
Touch Current	03/10/2014	< 0.07	mA	Pass

Overall: Pass

Asset ID: L49630	Description: PRINTER	User: ALEX	Test Instrument: 06E-0826
------------------	----------------------	------------	---------------------------

Test Type	Date	Result	Unit	Status
Visual	03/10/2014			Pass
Insulation Voltage	03/10/2014	500	V	Information
Insulation	03/10/2014	> 199	MOhm	Pass

Overall: Pass

Total Tests: 45

